


## Fan Powered Units — Intermittent Volume

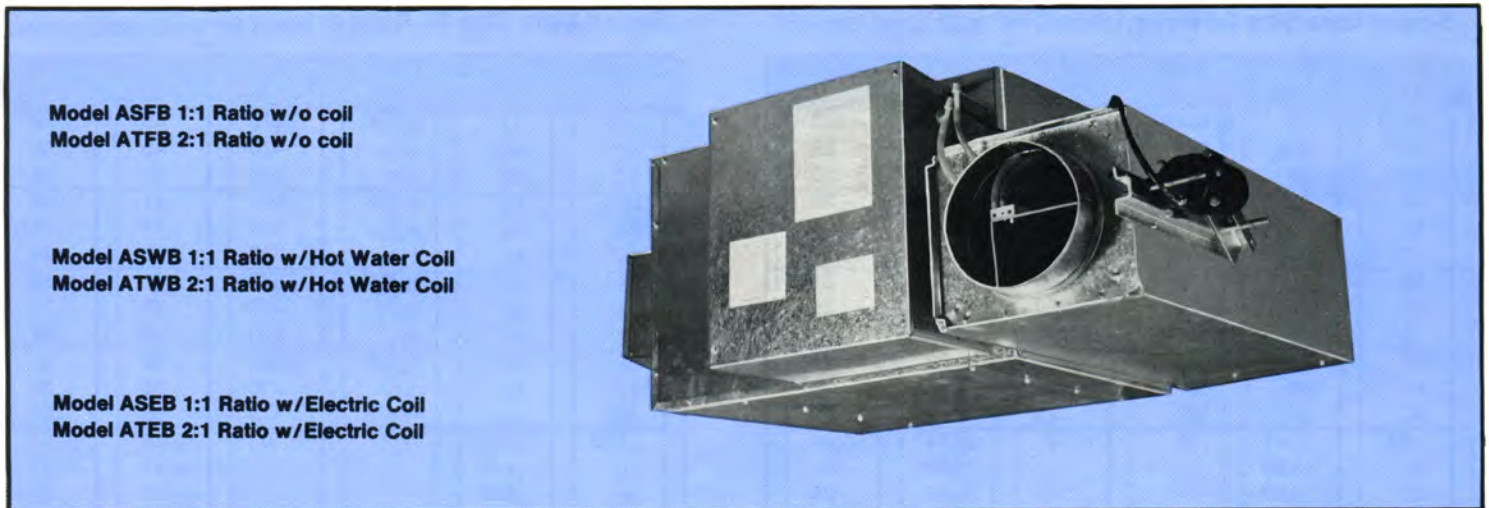

The Carnes intermittent fan terminal unit provides constant air volume to the space for reheat applications while retaining a variable air volume system during normal cooling operation.

The primary air control assembly operates independently as a standard throttling control valve for cooling loads. As cooling loads diminish, the secondary air supply fan is energized to induce warm ceiling plenum air. A wide variety of control sequences makes this fan powered unit compatible with the most energy efficient system design.

### Typical Sequence of Operation

Central fan on — Day (occupied) operation.

When the central system fan is “on”, the intermittent fan unit operates as a standard throttling control unit for cooling loads. As the cooling load diminishes and the control valve throttles to a minimum or closed position, the fan is energized by the P/E switch to draw in warm plenum air or hydronically or electrically reheated air.

Central fan off — Night (unoccupied) operation.

When the central system fan is “off”, the primary air supply valve is closed. The unit fan is then turned on and off by the P/E switch on demands for heat and no heat respectively.

### Features Include:


- Air flow capacities to 6000 CFM Primary Air and 3200 CFM Secondary Air.
- Two primary to secondary air ratio configurations are available.
- Access panel for internal components.
- Forward curved centrifugal type fan assemblies with SCR speed controlled permanent split capacitor type 115 or 277 volt fractional horsepower motors.
- Fan/motor assemblies are isolated from the casing using rubber isolators to minimize vibration transmission.
- Field adjustable P/E and air flow switches.
- All units are equipped with pneumatic or electronic pressure independent controls.
- Insulation is 1½ lb. density fiberglass with surface treated to prevent erosion, meets NFPA 90A requirements.
- Optional one or two row hot water coils (*Models ASWB/ATWB*). Coil is attached to secondary air inlet.
- Optional one, two or three stage electric reheat coils (*Models ASEB/ATEB*). Coil is attached to secondary air inlet.
- Velocity sensor and calibration chart for measuring air flow through the primary air damper.
- Optional filter rack.
- Optional quick release access panel.
- Optional fire rated tubing.
- Optional coated insulation (hospital, laboratory, etc. applications).

### Available Modules:

- Basic control unit—Models ASFB/ATFB.
- Basic control unit with hot water coil—Models ASWB/ATWB
- Basic control unit with or without electric coil—Models ASEB/ATEB.
- Discharge sound attenuator—Model AXAA. (See Section 5-Accessories.)
- Multi-Discharge adaptor—Model AXMA. (See Section 5-Accessories.)


# Dimensional Data—Models ASFB/ATFB-Intermittent Volume Fan Powered Unit

2

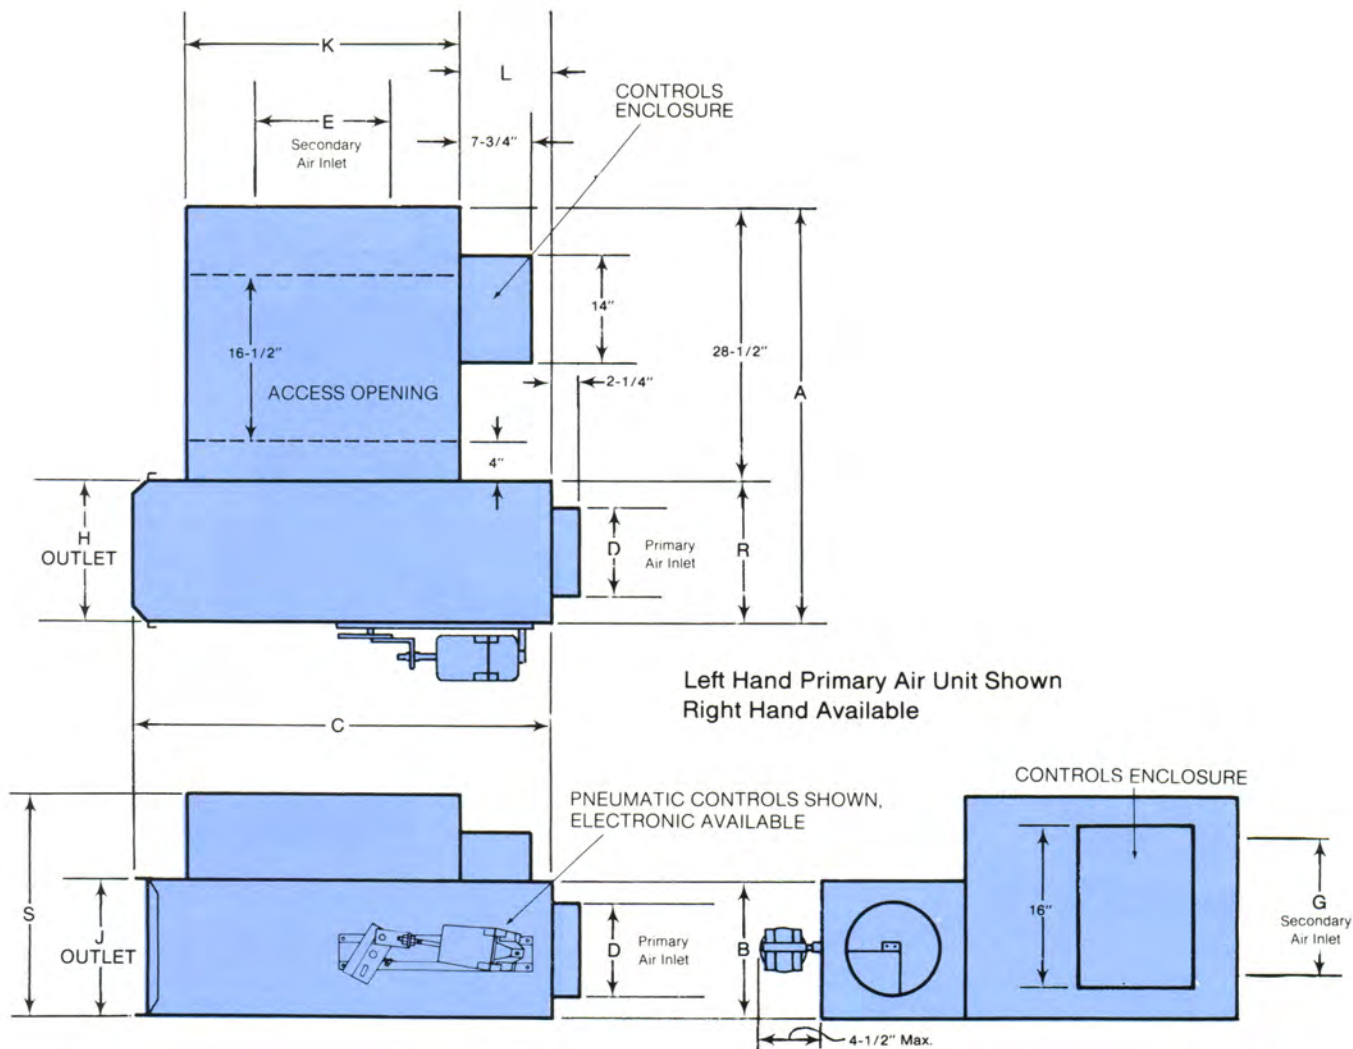

DIMENSION IN INCHES																
Unit Type	Unit Size	Prim. Nom. CFM	Sec. Nom. CFM	Fan H.P.	A	B	C	D	Secondary Air Inlet		S & Drive Outlet		K	L	R	S
									E	G	H	J				
ASFB 1:1 Ratio	04	400	400	1/8	38 1/2	8	27 1/2	6	10	8	10	8	19 1/2	5 7/8	10	18
	06	600	600	1/6	40 1/2	10	30 7/8	7	12	10	12	10	24	5 5/8	12	18
	08	800	800	1/4	40 1/2	10	33 3/8	8	14	12	12	10	26	5 1/2	12	18
	12	1200	1200	1/3	42 1/2	12	40	10	16	14	14	12	31	6 3/4	14	18
	16	1600	1600	1/2	44 1/2	14	41 1/2	12	18	16	16	14	33 1/2	6 5/8	16	18
	24	2400	2400	(2) 1/3	46 1/2	16	57 5/8	14	20	18	18	16	42	13 3/4	18	18
ATFB 2:1 Ratio	32	3200	3200	(2) 1/2	48 1/2	18	59 7/8	16	24	18	20	18	46 1/2	12 1/4	20	20
	08	800	400	1/8	38 1/2	10	29 3/8	8	10	8	12	10	19 1/2	8	12	18
	12	1200	600	1/6	42 1/2	12	33 3/8	10	12	10	14	12	24	7 3/4	14	18
	16	1600	800	1/4	44 1/2	14	36 3/8	12	14	12	16	14	26	8 1/2	16	18
	24	2400	1200	1/3	46 1/2	16	42 3/8	14	16	14	18	16	31	9 3/4	18	18
	32	3200	1600	1/2	48 1/2	18	45 1/2	16	18	16	20	18	33 1/2	10 5/8	20	18
	45	4500	2400	(2) 1/3	52 1/2	18	59 7/8	18 x 16	20	18	24	18	42	15 3/4	24	18
60	6000	3200	(2) 1/2	60 1/2	18	59 7/8	24 x 16	24	18	32	18	46 1/2	12 1/4	32	20	

## Model Numbering System—Models ASFB/ATFB-Control Unit

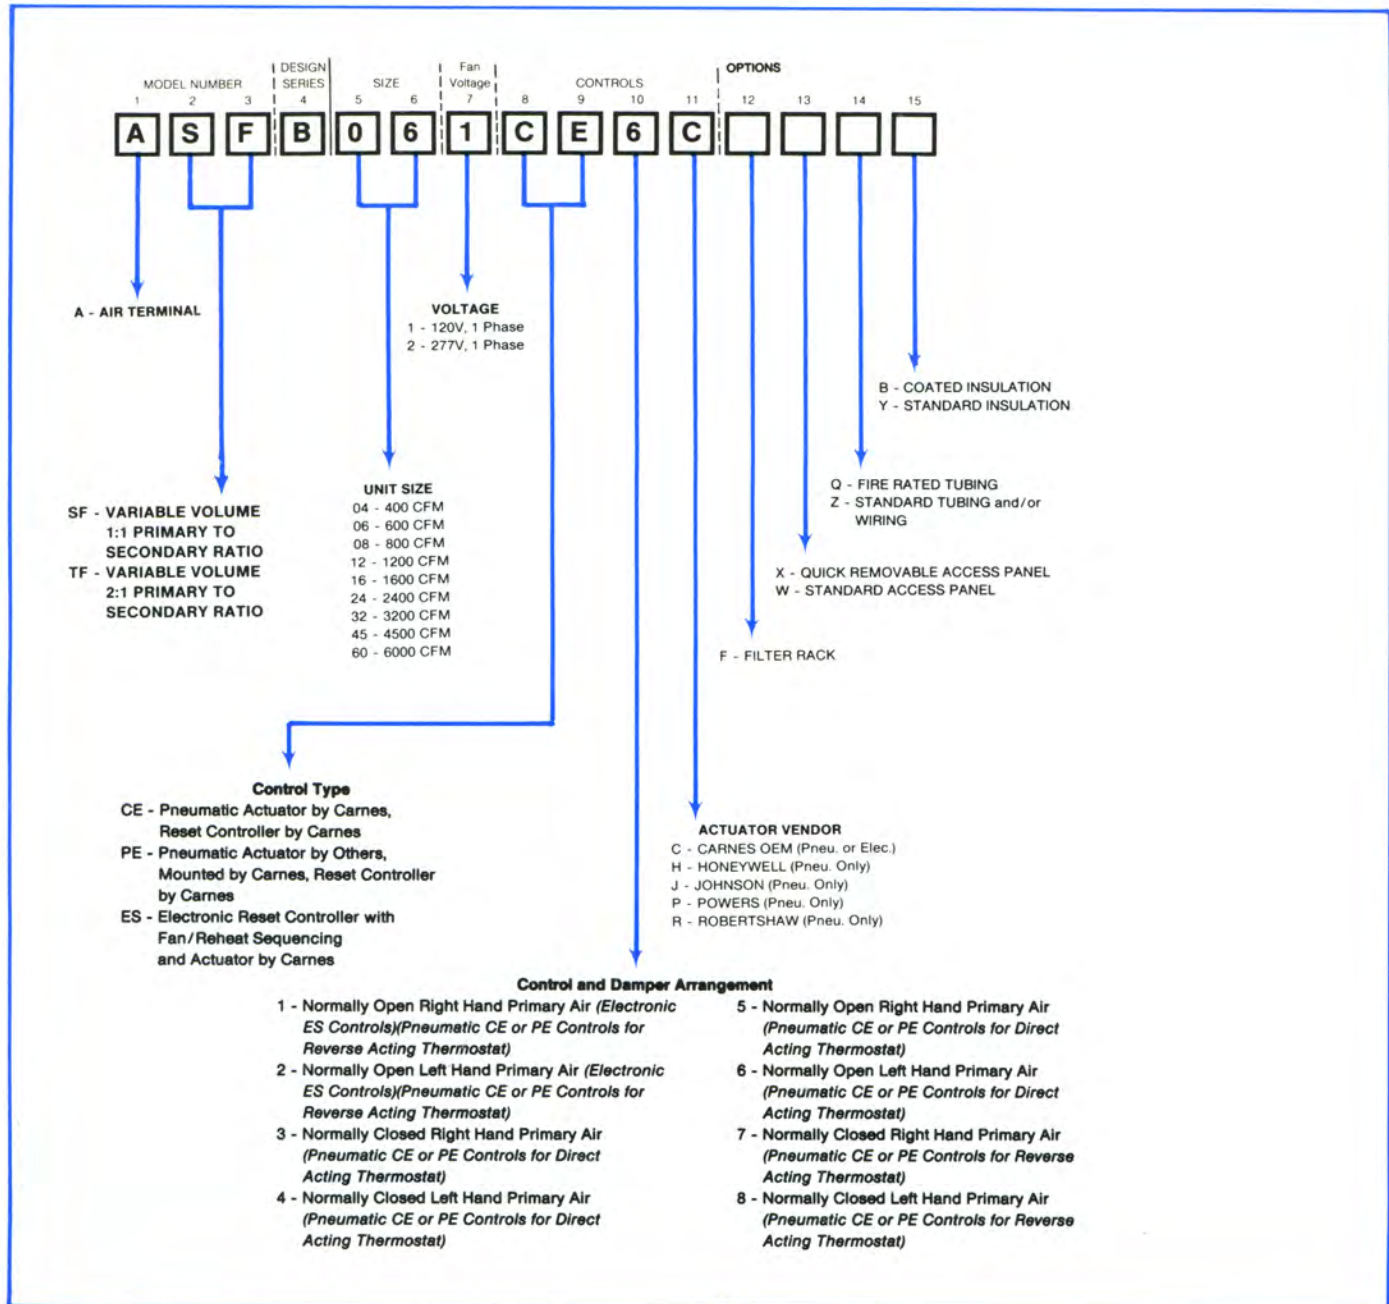

- NOTES:**
1. Hand of primary air side of unit is determined by facing the unit in the direction of air flow into the unit.
  2. Standard motor voltages for 1:1 unit type are 277 volts for sizes 04-32 and 115 volts for sizes 04-16. Standard motor voltages for 2:1 unit type are 277 volts for sizes 08-60 and 115 volts for sizes 08-32.
  3. Filter not included with filter rack.