



Model Numbering - Constant Volume (Series Flow), Standard Design ECM

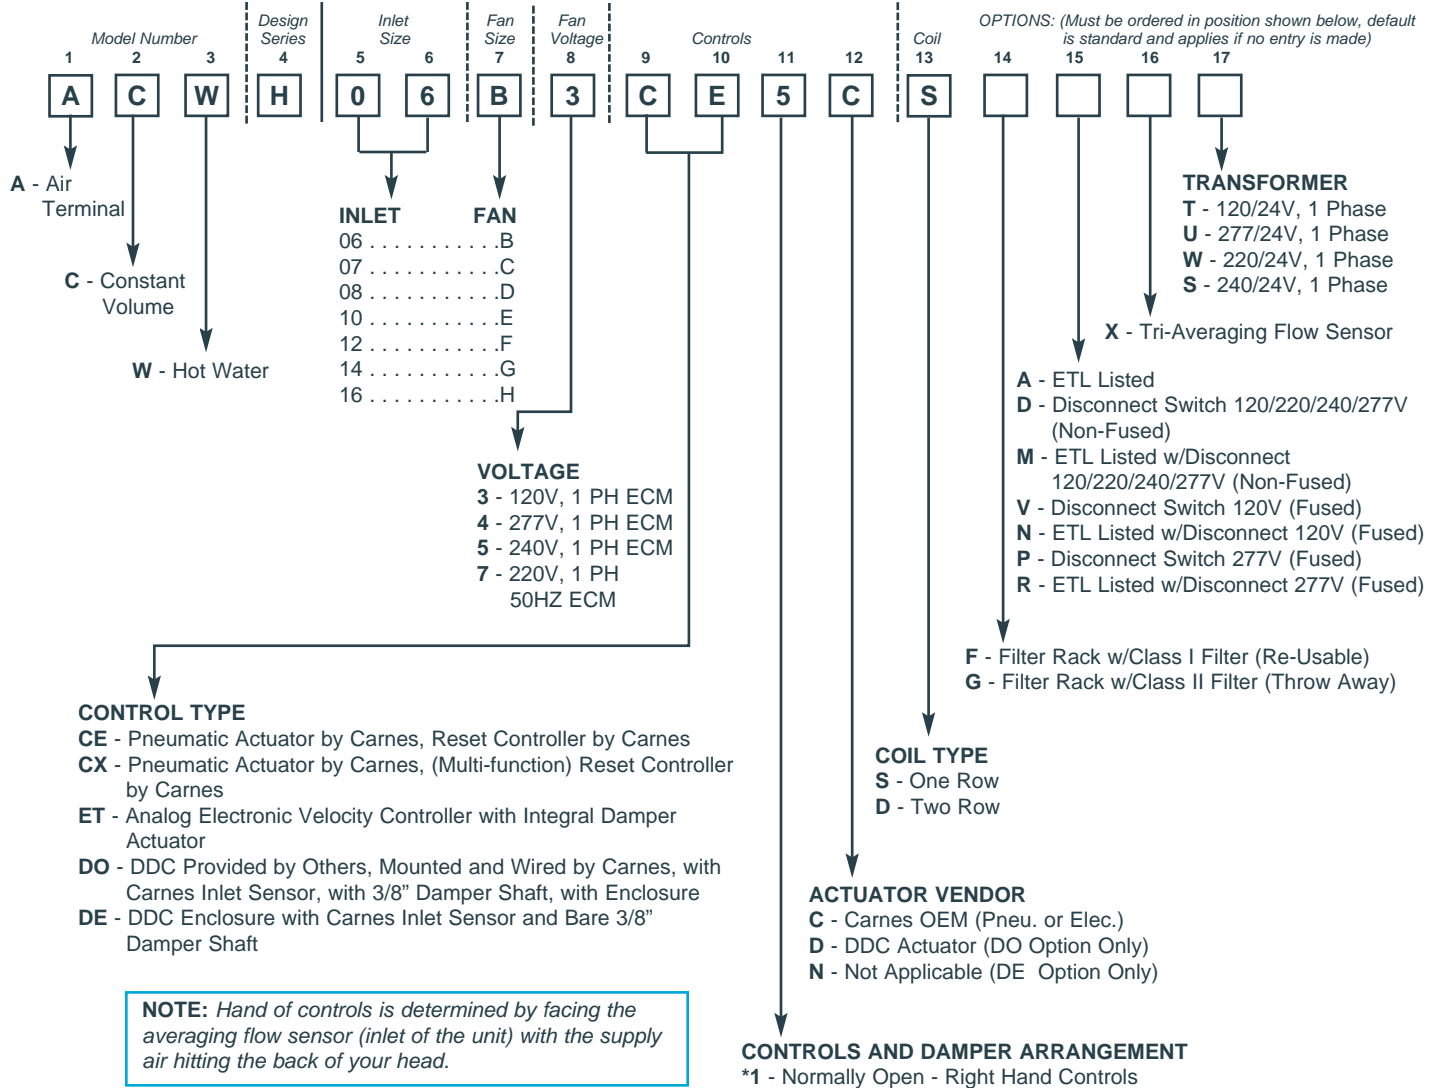

- CONTROLS AND DAMPER ARRANGEMENT**
- *1 - Normally Open - Right Hand Controls (Electronic/DO, DE, ET)
(All Pneumatic Control Types for Reverse Acting Thermostat)
 - *2 - Normally Open - Left Hand Controls (Electronic/DO, DE, ET)
(All Pneumatic Control Types for Reverse Acting Thermostat)
 - 3 - Normally Closed - Right Hand Controls (All Pneumatic Control Types for Direct Acting Thermostat)
 - 4 - Normally Closed - Left Hand Controls (All Pneumatic Control Types for Direct Acting Thermostat)
 - 5 - Normally Open - Right Hand Controls (All Pneumatic Control Types for Direct Acting Thermostat)
 - 6 - Normally Open - Left Hand Controls (All Pneumatic Control Types for Direct Acting Thermostat)
 - 7 - Normally Closed - Right Hand Controls (All Pneumatic Control Types for Reverse Acting Thermostat)
 - 8 - Normally Closed - Left Hand Controls (All Pneumatic Control Types for Reverse Acting Thermostat)

*Electronic and DDC Units DO NOT Fail Open. "1" or "2" is used for Right or Left Hand Only. Electronic Units are shipped with the Damper in Open Position.

Electronic Thermostat

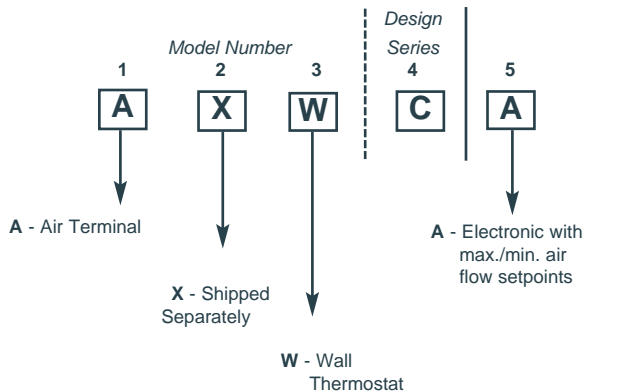

A Carnes Electronic Thermostat **must be ordered** with the Electronic ET Control Option.